
interact


Wireless gateway Interact Pro LCN1840



Installation Instructions

Instructions d'installation Instrucciones de instalación Istruzioni per l'installazione Installatie-instructies Installationsanweisungen インストール手順 安装指示书 إرشادات التركيب

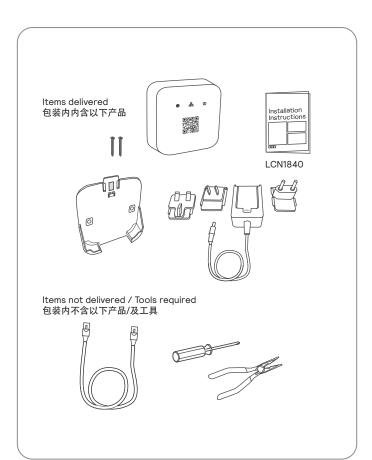

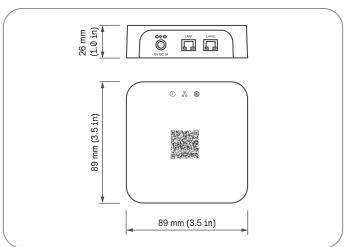

















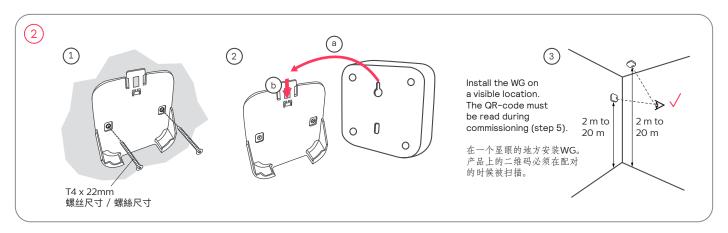

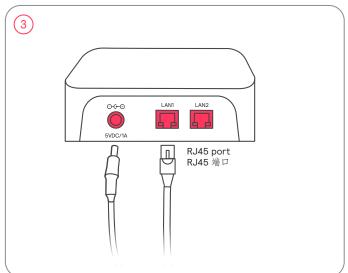

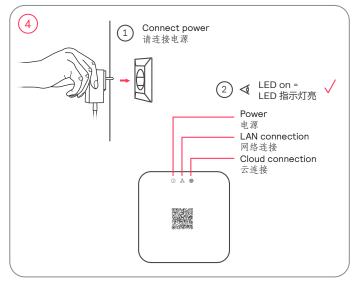

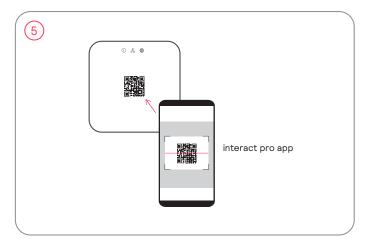

A portal to access Interact PRO is available at: <u>https://sme.interact-lighting.com</u> (world except China) <u>https://sme.interact-lighting.cn</u> (China)

■ Note

This product contains open source software. The acknowledgements, license texts and the written offer can be retrieved from the product by opening the http page of this product.

三 注意

该产品含有开源软件。相关的声明, 版权等信息均可通过访问该产品http网页获得

are owned by Signify Holding or their respective owners.

© 2019-2020 Signify Holding. All rights reserved. Specifications are subject to change without notice. No representation or warranty as to the accuracy or completeness of the information included herein is given and

any liability for any action in reliance thereon is disclaimed. All trademarks

FCC Compliance Statement

This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

IC Compliance Statement

This device complies with Industry Canada license-exempt RSSs. Operation is subject to the following two conditions: (1) this device may not cause interference, and (2) this device must accept any interference, including interference that may cause undesired operation of the device.

Any changes or modifications not expressly approved by Signify could void the user's authority to operate this equipment. This equipment is intended for commercial use only.

FCC Radiation Exposure Statement

This equipment complies with FCC radiation exposure limits set forth for an uncontrolled environment.

This equipment should be installed and operated with minimum distance 20 cm between the radiator & your body.

IC Radiation Exposure Statement

This equipment complies with IC RSS-102 radiation exposure limits set forth for an uncontrolled environment.

This equipment should be installed and operated with minimum distance 20 cm between the radiator & your body.

(FR) Cet équipement est conforme aux limites d'exposition aux rayonnements IC établies pour un environnement non contrôlé.

Cet équipement doit être installé et utilisé avec un minimum de 20cm de distance entre la source de rayonnement et votre corps.



Find out more about Interact www.interact-lighting.com